
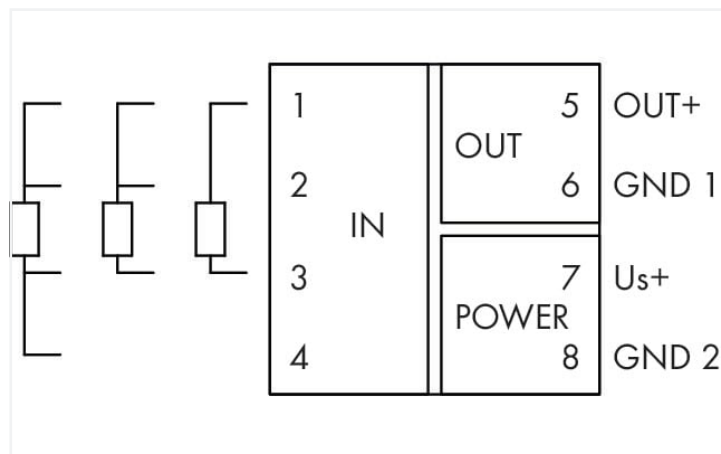



Data Sheet | Item Number: 857-800

Temperature signal conditioner for RTD sensors; Current and voltage output signal;
Configuration via DIP switch; Supply voltage: 24 VDC; 6 mm module width; light gray

<https://www.wago.com/857-800>

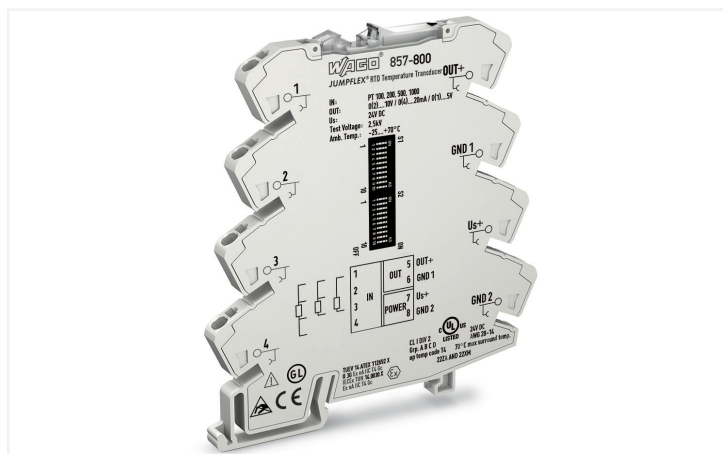

Color: light gray

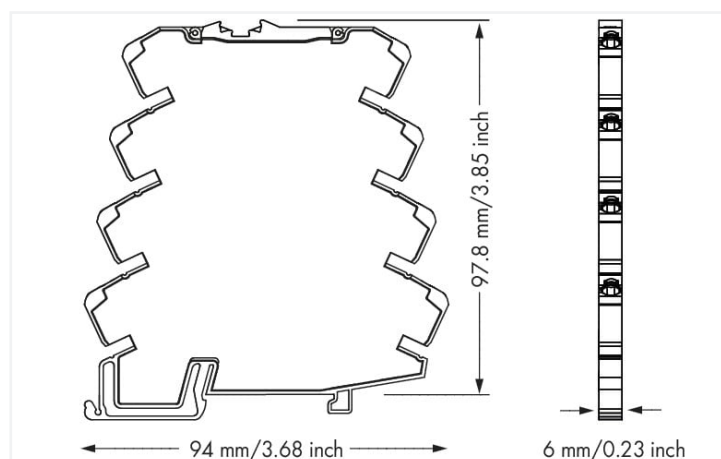[illegible]

Dimensions in mm

Short description:

WAGO's temperature signal conditioner records Pt100, Pt200, Pt500, and Pt1000 sensors, as well as resistors up to 4.5 kOhm, converting the temperature signal into a standard analog signal at the output.

Features:

- For Pt100, Pt200, Pt500 and Pt1000 sensors, as well as resistors up to 4.5 kOhm
- 2-, 3- and 4-wire connection technology
- Calibrated measurement range switching
- Detects a sensor wire break/short circuit
- Detects measurement range underflow/overflow
- Clipping capability for analog signal limitation to output end values
- 3-way electrical isolation with 2.5 kV test voltage

Technical data

Configuration

Configuration options

DIP switch

Input

Input signal type

Pt sensors
Resistance



Input (RTD sensors)	
Sensor types (RTD)	Pt100 Pt200 Pt500 Pt1000
Sensor connection	2-wire; 3-wire; 4-wire (switchable)
Sensor power supply (RTD) max.	≤ 0.5 mA
Temperature measurement range (RTD)	-200 ... 850°C

Input (resistors)	
Input range (resistor)	0 ... 1 kΩ; 0 ... 4.5 kΩ

Output (analog)	
Output signal type	Current Voltage
Output signal (voltage)	0 ... 5 V; 1 ... 5 V; 0 ... 10 V; 2 ... 10 V
Output signal (current)	0 ... 10 mA; 2 ... 10 mA; 0 ... 20 mA; 4 ... 20 mA
Load impedance (voltage output)	≥ 2 kΩ
Load impedance (current output)	≤ 600 Ω

Signal processing	
Step response (typ.)	180 ms (2-wire); 360 ms (3-wire)

Measurement error	
Transmission error (typ.)	≤ 0.1 % at full measurement span
Transmission error for the set measurement range	≤ ((10 K/set measurement range [K]) + 0.1) %
Temperature coefficient	≤ 0.02 %/K

Power supply	
Power supply type	24 VDC
Nominal supply voltage U _S	DC 24 V
Supply voltage range	±30 %
Current consumption at nominal supply voltage	≤ 40 mA

Safety and protection	
Protection type	IP20
Test voltage	
Test voltage (input/output/supply)	AC 2.5 kV; 50 Hz; 1 min

Connection data	
Connection technology	Push-in CAGE CLAMP®
Solid conductor	0.08 ... 2.5 mm² / 28 ... 14 AWG
Fine-stranded conductor	0.34 ... 2.5 mm² / 22 ... 14 AWG
Strip length	9 ... 10 mm / 0.35 ... 0.39 inches

Physical data	
Width	6 mm / 0.236 inches
Height	94 mm / 3.701 inches
Depth from upper-edge of DIN-rail	97.8 mm / 3.85 inches

Mechanical data	
Mounting type	DIN-35 rail



Material data	
Color	light gray
Fire load	0.418 MJ
Weight	35.3 g

Environmental requirements	
Ambient temperature (operation)	-25 ... +70 °C
Ambient temperature (storage)	-40 ... +85 °C
Relative humidity	5 ... 95 % (no condensation permissible)
Operating altitude (max.)	2000 m

Standards and specifications	
Conformity marking	CE
EMC immunity to interference	EN 61000-6-2
EMC emission of interference	EN 61000-6-4
Standards/specifications	DNV

Commercial data	
Product Group	6 (INTERFACE ELECTRONIC)
eCl@ss 10.0	27-21-01-29
eCl@ss 9.0	27-20-02-06
ETIM 8.0	EC002919
ETIM 7.0	EC002919
PU (SPU)	1 pcs
Packaging type	Bag
Country of origin	DE
GTIN	4045454470128
Customs tariff number	85437090300

Environmental Product Compliance	
CAS-No.	1303-86-2 1317-36-8 7439-92-1 75980-60-8 79-94-7
REACH Candidate List Substance	2,2',6,6'-tetrabromo-4,4'-isopropylidenediphenol Diboron trioxide Lead Lead monoxide Phosphine oxide, diphenyl(2,4,6-trimethylbenzoyl)-
RoHS Compliance Status	Compliant,With Exemption
RoHS Exemption	6(c) 7(a) 7(c)-I 7(c)-II
SCIP notification number (Austria)	18d0a87d-bb35-4b42-bba2-e1971d4739b1
SCIP notification number (Belgium)	1f2fe9d0-536a-4644-aa00-574d7a086709
SCIP notification number (Bulgaria)	6eb8b90b-e755-4cdf-9d9f-85f513b2f530
SCIP notification number (Czech Republic)	03108352-4dba-454f-a6f1-d4e09f8cc18d
SCIP notification number (Denmark)	26a58e4c-5504-4e78-9b49-eb746565ddd1
SCIP notification number (Finland)	4e48f299-96d8-4f28-9c0f-d3b571642d51
SCIP notification number (France)	13292952-78df-4879-8c6e-21dcd8da9daf
SCIP notification number (Germany)	4f8414b3-3970-470e-8a6d-e6b490c7716a
SCIP notification number (Hungary)	c7c0edf4-0baa-4704-bf79-5e09253a732b
SCIP notification number (Italy)	63af3c96-c94e-457c-94e9-0491f5c3e31f
SCIP notification number (Netherlands)	fe840f60-0242-44fe-9a9d-212ece7599cf
SCIP notification number (Poland)	ea6a54b1-1413-4f99-b8a2-510158b8a5d9



Environmental Product Compliance	
SCIP notification number (Romania)	202d51cb-6c22-4e4c-a67c-2542b8e82bd1
SCIP notification number (Sweden)	95ed46b3-c0f7-472f-987f-304709c7024f

Approvals / Certificates	
General approvals	Declarations of conformity and manufacturer's declarations

Approval	Standard	Certificate Name
EAC Brjansker Zertifizierungs- stelle	TP TC 020/2011	EAC_Certificate_RU_C- DE.AM02.B.00115_19
UL Underwriters Laboratories Inc. (ORDINARY LOCATI- ONS)	UL 508	E175199 Sec.4

Approval	Standard	Certificate Name
EU-Declaration of Confor- mity WAGO GmbH & Co. KG	-	-

Approval	Standard	Certificate Name
BV Bureau Veritas S.A.	Rules for class. of Steel Ships	40179_B0
DNV DNV Germany GmbH	DNV-CG-0339,Aug.2021	TAA00001D1
PRS Polski Rejestr Statków	-	TE/2186/880590/18

Approval	Standard	Certificate Name
CCC CNEX	CNCA-C23-01	2020312310000210 (Ex ec IIC T4 Gc)
EAC Brjansker Zertifizierungs- stelle	TP TC 012/2011	EAC RU C-DE.AM02. B.00144/19 (2 Ex nA IIC T4 Gc X)
IECEx TUEV Nord Cert GmbH	-	IECEX TUN14.0030X
UKEx WAGO GmbH & Co. KG	EN 60079-0	WAGO22UKEX004X
UL Underwriters Laboratories Inc. (HAZARDOUS LOCA- TIONS)	ANSI/ISA 12.12.01	E198726

Downloads	
Environmental Product Compliance	
Compliance Search	
Environmental Product Compliance 857-800	



Documentation

Manual				Bid Text			
WAGO Temperature Signal Conditioners				857-800	19.02.2019	xml 5.96 KB	
				857-800	20.02.2019	docx 16.85 KB	


Instruction Leaflet			
CCC Ex (Additional information)	26.04.2023	pdf 140.99 KB	
Messumformer und Trennverstärker		pdf 2194.14 KB	

CAD/CAE-Data

CAD data		CAE data	
2D/3D Models 857-800		EPLAN Data Portal 857-800	
		WSCAD Universe 857-800	
		ZUKEN Portal 857-800	


Installation Notes

Configuring



Configuration via DIP switch

Commoning



Commoning, not discrete wiring – Same outline allows use of a single in-line, push-in jumper.